



Backup repeater with 3h charging time for 15 hours of operation.
Leaves the network operational for 15 hours in case of power failure (timer).
To pair, the Backup Repeater must be connected to the power supply for at least 30 minutes.

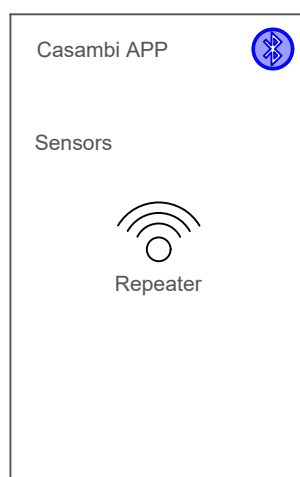

Wiring Diagram: LIGA air module
Luminaire Model: ...
Control: Repeater (230VAC) / Battery backup

LIGA.AIR.TIMEBACKUP+
V1.3 / 31.07.2023

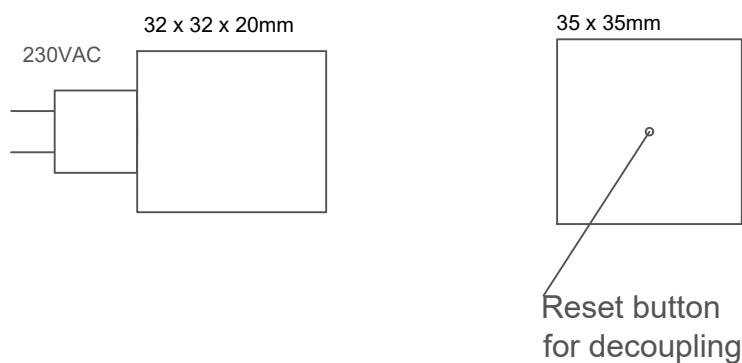

LIGA AIR

LICHTTEAM AG
Stationsstrasse 89
CH-6023 Rothenburg
SWITZERLAND

+41 41 280 57 57
mail@ligaair.ch
www.ligaair.ch

